



**Ontario Clean Water Agency**  
**Agence Ontarienne Des Eaux**

# West Lorne Wastewater Treatment Plant

## Operations Report

### Second Quarter 2024

Ontario Clean Water Agency, Southwest Region

Sam Smith, Senior Operations Manager

Date: August 12, 2024

## **Facility Information**

Name:	Township of West Elgin Distribution System
Hub Name:	Southwest Region – SWM/Alvinston Cluster
Regional Hub Manager:	Sam Sianas (519) 319-2233
Senior Operations Manager:	Sam Smith (226) 377-1540
Business Development Manager:	Robin Trepanier (519) 791-2922
Facility Type:	Municipal
Classification:	Class 1 Water Distribution
Drinking Water System Category:	Large Municipal Residential

## **Operational Description:**

The village of West Lorne is served by an extended aeration Wastewater Treatment Plant, comprised of aeration, clarification, filtration, disinfection and sludge disposal. Also included is the collection system with one pumping station and a sanitary sewer system. The operations are in accordance to ECA # 5873-B4RLEJ, which covers the entire plant including the pumping stations.

The collection system consists of sewers and one submersible pumping station. The treatment facility main elements are an extended aeration process designed for combined carbon removal and nitrification. The discharge of secondary clarifier: effluent is filtered and disinfected with ultraviolet light before being reaerated and discharged to the Zoller Drain and then Brocks Creek. The waste activated sludge is discharged to a lagoon for storage. Dual-point chemical addition alum: is used for phosphorus removal. Sodium hydroxide is added for control of alkalinity.

## **Service Information**

Areas Served:	Village of West Lorne
---------------	-----------------------

## **Design Capacity:**

Total Design Capacity:	900 m <sup>3</sup> /day
Total Annual Flow (2022 Data):	151,530 m <sup>3</sup> /year
Average Day Flow (2022 Data):	415 m <sup>3</sup> /day
Maximum Day Flow (2022 Data):	1,962 m <sup>3</sup> /day

## **Treatment Process Features:**

Effluent Receiver:	Zoller Drain to Brocks Creek to Lake Erie
Major Process:	Extended aeration
Phosphorus Removal:	Continuous, Alum addition
Additional Treatment:	Effluent filtration
Discharge Mode:	Continuous discharge
Effluent Disinfection Practice:	UV Disinfection
Sludge Stabilization:	Lagoon storage

## SECTION 1: COMPLIANCE SUMMARY

### FIRST QUARTER:

There were no compliance or exceedance issues to report during the first quarter.

### SECOND QUARTER:

There were no compliance or exceedance issues to report during the second quarter.

## SECTION 2: INSPECTIONS

### FIRST QUARTER:

There were no MECP or MOL inspections conducted in the first quarter.


### SECOND QUARTER:

There were no MECP or MOL inspections conducted in the second quarter.

## SECTION 3: PERFORMANCE ASSESSMENT REPORT

The average daily raw flow for the wastewater treatment plant so far in 2024 is 771.6m<sup>3</sup>/d. The average daily flow in 2023 was 637.5 m<sup>3</sup>/d, therefore the flow for 2024 is up 21% when compared to 2023. The plant is currently at 85.7 % of its rated capacity of 900m<sup>3</sup>/d.

**Chart 1. Raw flows in 2024 Compared to 2023 Flows**

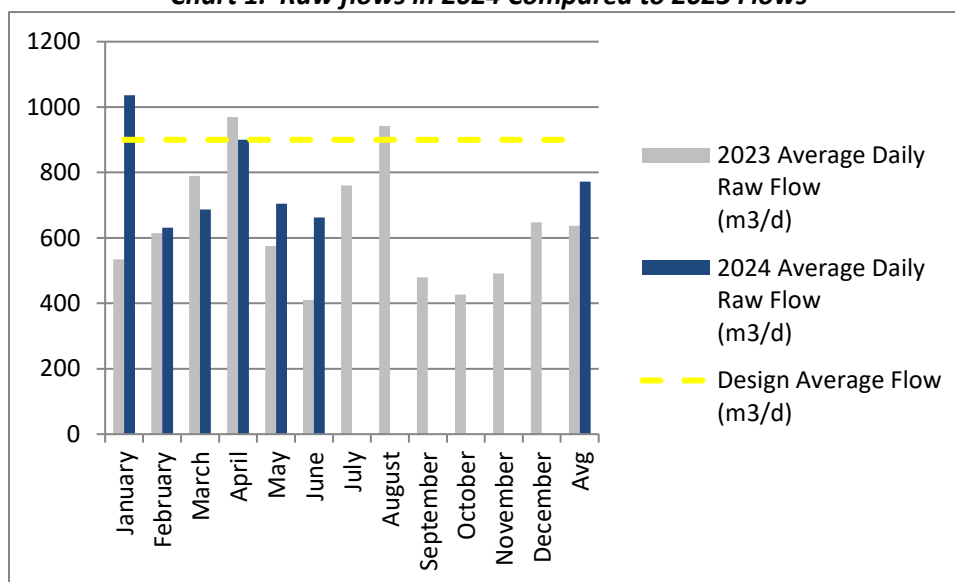

Raw samples are taken on a biweekly basis following the ECA requirements. The table below shows the raw sample results for 2024.


**Table 1. Raw Water Sample Results for 2024.**

	BOD5 (mg/L)	TKN (mg/L)	TP (mg/L)	TSS (mg/L)	Alkalinity (mg/L)
January Results	43.5	19.8	1.56	40	291.5
February Results	47	17.1	1.4	57.5	251.5
March Results	46	8.45	0.645	50.5	191.5
April Results	65.33	17.97	1.94	68.33	264.67
May Results	111.5	18.9	1.92	149	251.5
June Results	95.5	12.95	1.64	139	206
July Results	-	-	-	-	-
August Results	-	-	-	-	-

	BOD5 (mg/L)	TKN (mg/L)	TP (mg/L)	TSS (mg/L)	Alkalinity (mg/L)
<b>September Results</b>	-	-	-	-	-
<b>October Results</b>	-	-	-	-	-
<b>November Results</b>	-	-	-	-	-
<b>December Results</b>	-	-	-	-	-
<b>Annual Average</b>	<b>67.92</b>	<b>16.02</b>	<b>1.55</b>	<b>82.85</b>	<b>244.46</b>

The average daily effluent flow for the wastewater treatment plant so far in 2024 was 812.3m<sup>3</sup>/d. The average daily flow in 2023 was 671.8 m<sup>3</sup>/d, therefore the flow for 2024 is up 21% when compared to 2023.


**Chart 2. Raw flows in 2024 Compared to 2023 Flows**

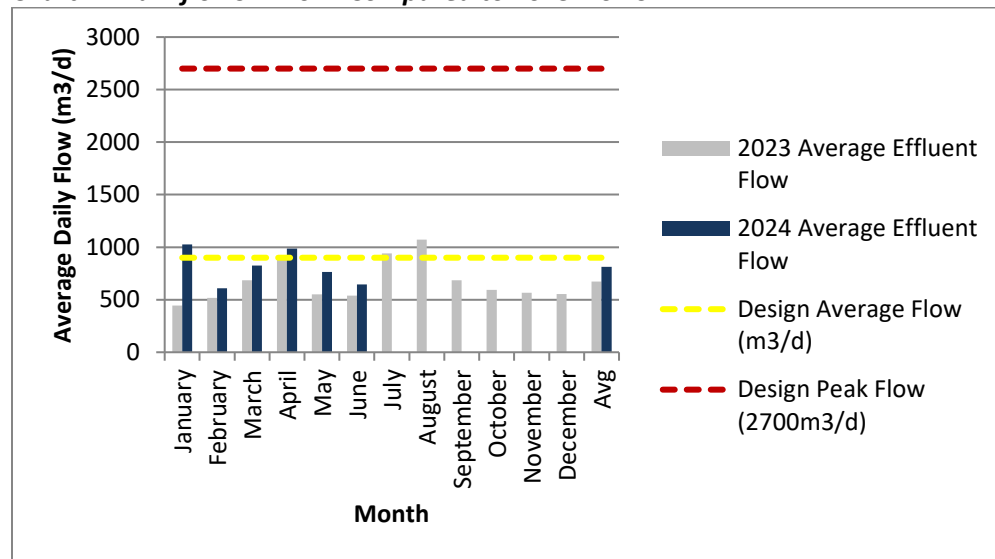

The effluent is sampled on a bi-weekly basis following the requirements of the ECA.


The average effluent cBOD5 so far for 2024 was 2.7mg/L, meeting the objectives and limits identified in the ECA. The annual average result for cBOD5 in 2023 was 2.4mg/L, therefore the results so far for 2024 are up by 12% when compared to 2023 (refer to Chart 3).

**Chart 3. Average Monthly Effluent cBOD5 Results for 2024 Compared to 2023**

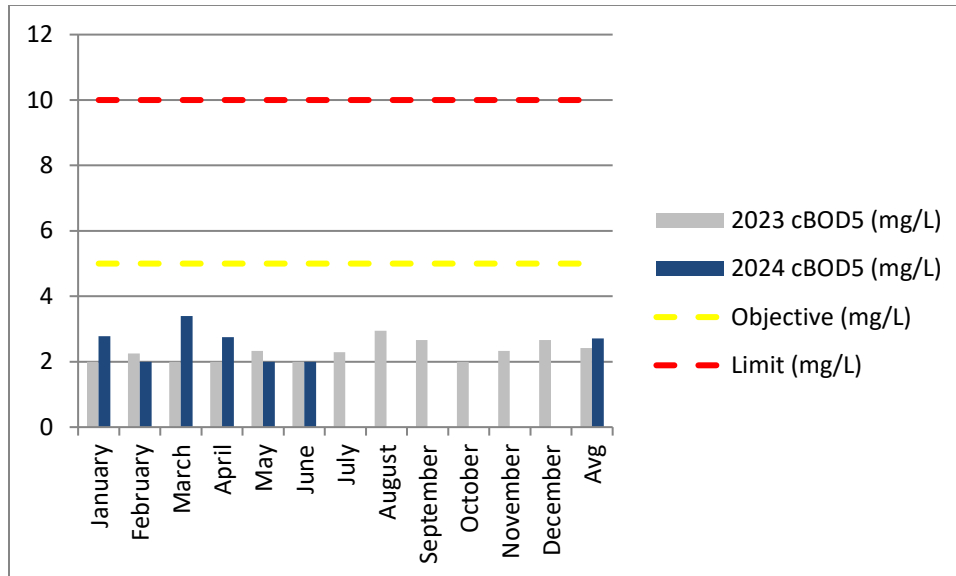


The average effluent TSS so far for 2024 was 5.4mg/L, meeting the effluent limits identified in the ECA but exceeding the objective in January, March and April due to high flows. The annual average result for TSS in 2023 was 6.6mg/L; therefore, the results so far for 2024 are down by 18.6% when compared to 2023 (refer to Chart 4).

**Chart 4. Average Monthly Effluent Total Suspended Solids Results for 2024 Compared to 2023**

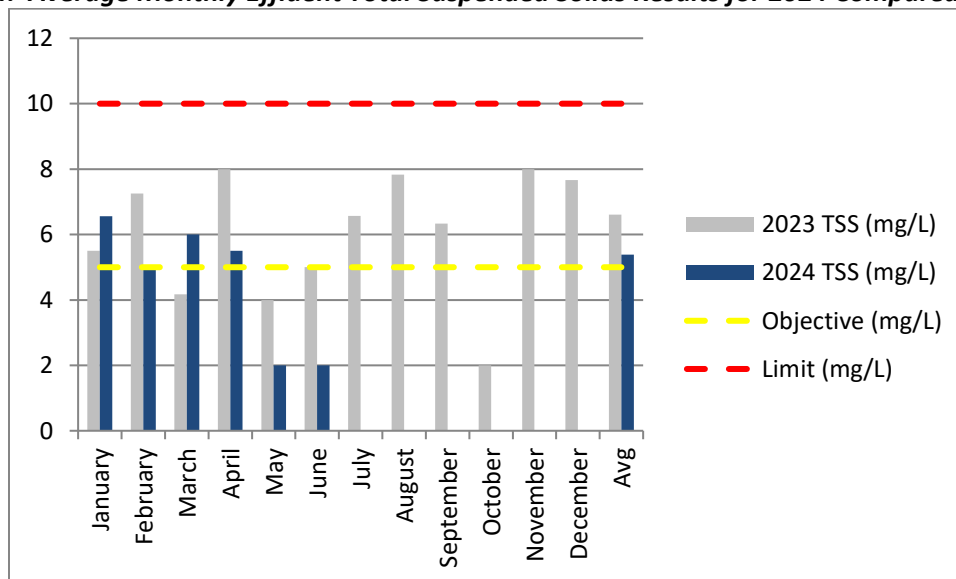


The average effluent TP so far for 2024 is 0.12 mg/L, meeting effluent objective and limits identified in the ECA. The annual average result for TP in 2023 was 0.12mg/L, therefore the results so far for 2024 is the same when compared to 2023 (refer to Chart 5).

**Chart 5. Average Monthly Effluent Total Phosphorus Results for 2024 Compared to 2023**

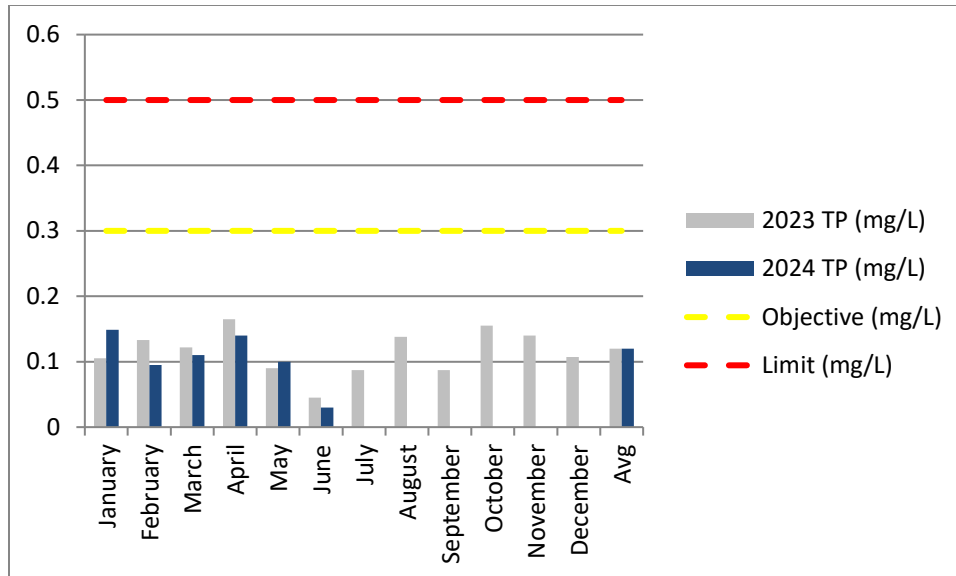


The average effluent TAN so far for 2024 is 0.58mg/L, meeting the effluent limits identified in the ECA but exceeding the objective in June to half the process down for maintenance. The annual average result for TAN in 2023 was 0.18mg/L, therefore so far the results for 2024 are up 222% compared to 2023 (refer to Chart 6).

**Chart 6. Average Monthly Effluent Total Ammonia Nitrogen Results for 2024 Compared to 2023**

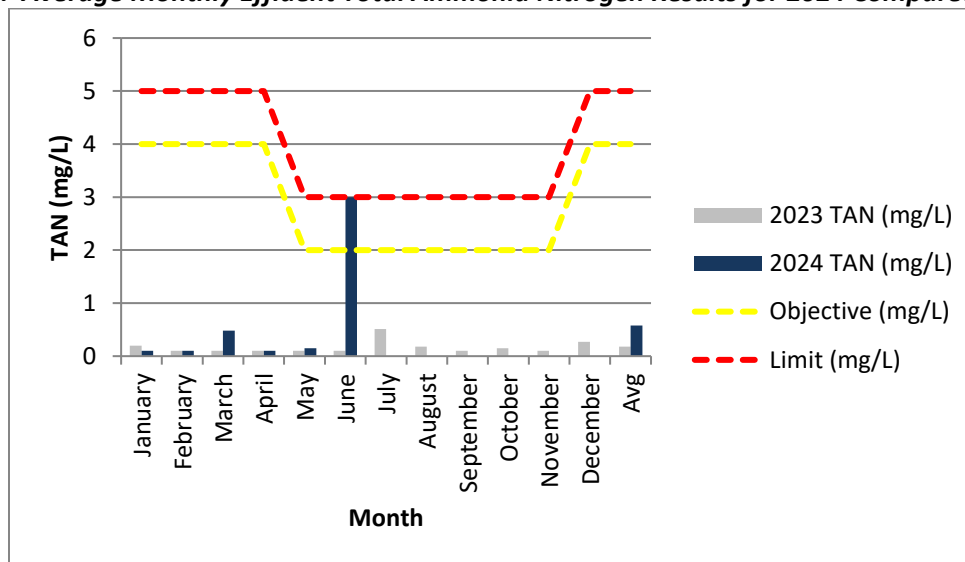


Dissolved oxygen (DO) in the effluent is measured on site in accordance with the ECA. The ECA identifies an objective of a minimum of 5mg/L. The objective was exceeded in June do to the maintenance being completed at the plant. The chart below (chart 7) shows the minimum DO concentrations.

**Chart 7. Minimum Dissolved Oxygen (DO) Results for 2024 Compared to 2023**

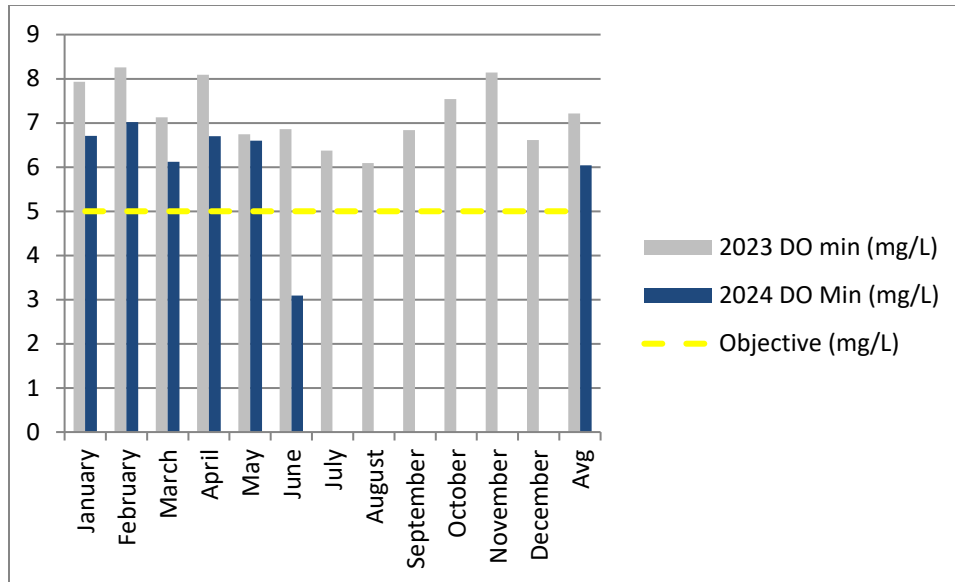


Total Kjeldahl Nitrogen (TKN) is sampled bi-weekly in accordance with ECA; there are no objectives or limits imposed on this parameter. The average effluent TKN so far for 2024 was 1.4mg/L. The annual average result for TKN in 2023 was 0.86mg/L, therefore the results so far for 2024 are up by 63% when compared to 2023 (refer to Chart 8).

**Chart 8. Average TKN Results for 2024 Compared to 2023**

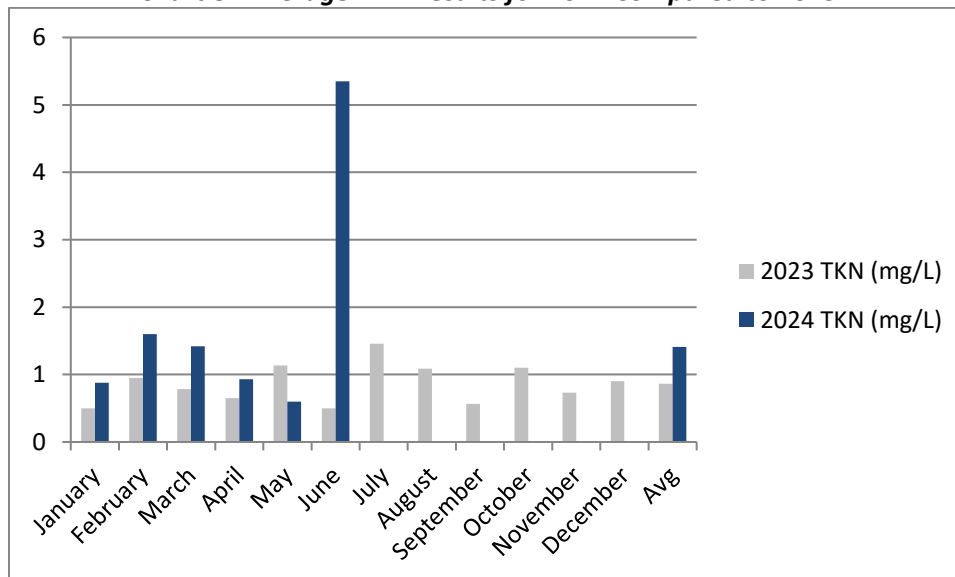


Alkalinity is sampled biweekly in accordance with ECA requirements; there are no objectives or limits imposed on this parameter. It is recommended that at least 50mg/L is present in the effluent. The average effluent alkalinity so far for 2024 was 151mg/L. The annual average result for alkalinity in 2023 was 119mg/L, therefore the results so far for 2024 are up by 27% when compared to 2023(refer to Chart 9).

**Chart 9. Average Alkalinity Results for 2024 Compared to 2023**

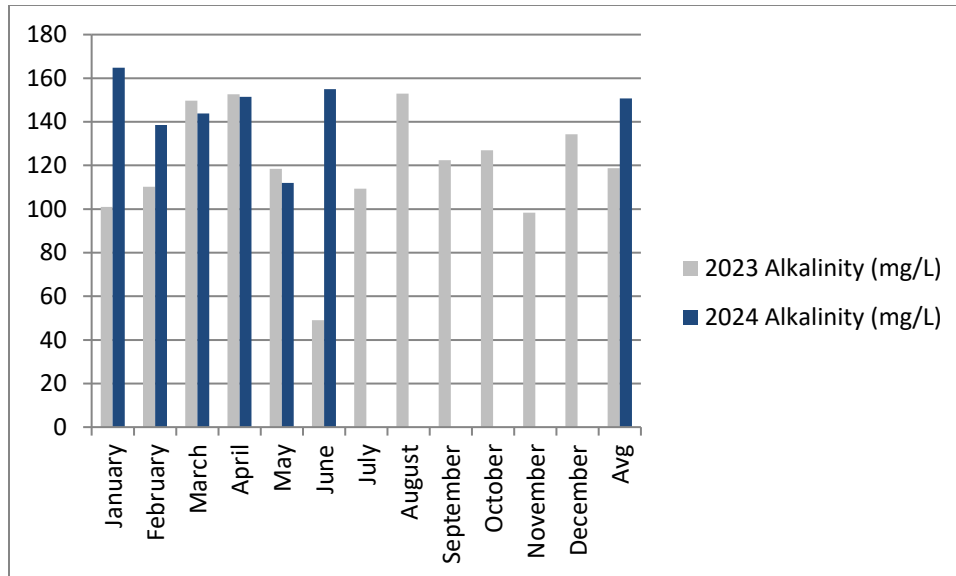

pH is sampled at least biweekly in accordance with ECA requirements; there are no objectives or limits imposed on this parameter. It is recommended that the pH be maintained between 6.5 and 8.5. The average effluent pH so far for 2024 was 7.34. The annual average result for pH in 2023 was 7.50, therefore the results for 2024 are down by 2% when compared to 2023 (refer to Chart 10).


**Chart 10. Average pH Results for 2024 Compared to 2023**

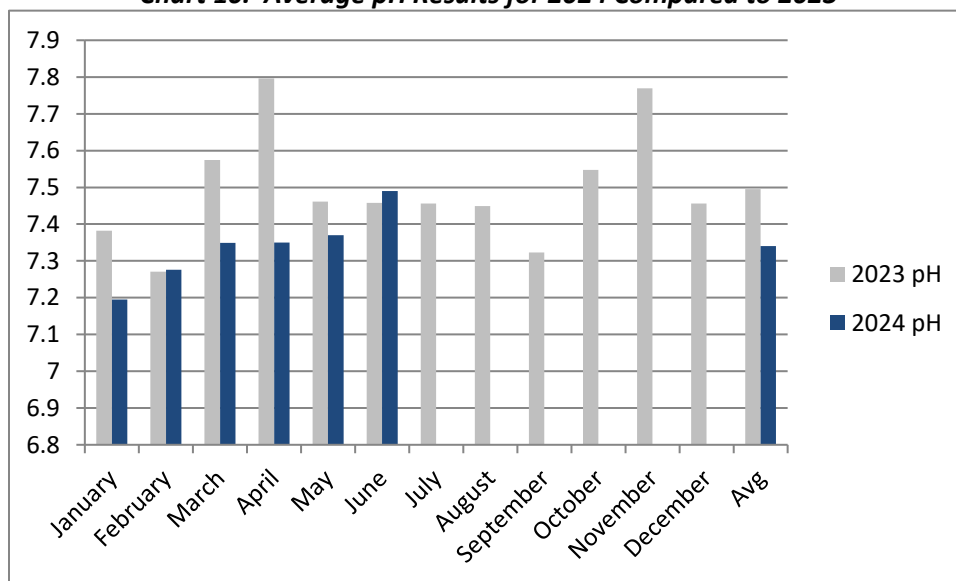

Temperature is measured at least biweekly in accordance with ECA requirements; there are no objectives or limits imposed on this parameter. The temperature of the effluent fluctuates based on outdoor temperatures. The average effluent temperature so far for 2024 was 11.4°C. The annual average temperature in 2023 was 13.8°C, therefore the results for 2024 are down by 17% when compared to 2023 (refer to Chart 11).

**Chart 11. Average Temperature Results for 2024 Compared to 2023**



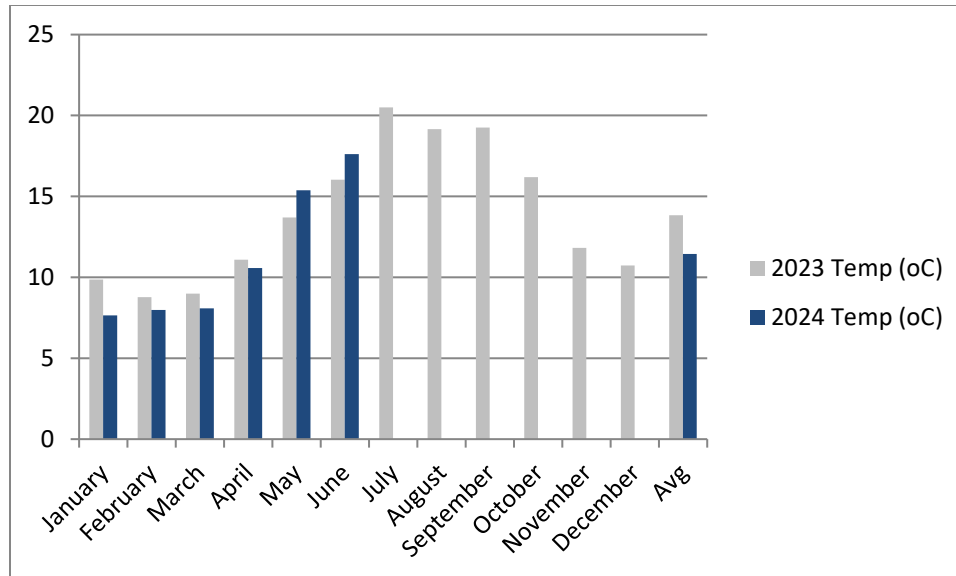

#### **SECTION 4: OCCUPATIONAL HEALTH & SAFETY**

##### **FIRST QUARTER:**

There were no Health & Safety issues identified during the first quarter.

##### **SECOND QUARTER:**

On May 13, 2024 the annual workplace Inspection was completed. No corrective issues were found.

#### **SECTION 6: GENERAL MAINTENANCE**

##### **FIRST QUARTER:**

###### **JANUARY**

- 10: High flow samples were collected due to heavy rain weather events in the area.
- 12: Collected high flow samples due to heavy rain and snow melt in the area.
- 15: Collected high flow samples for the weekend flows due to heavy rain in the area.
- 16: Gerber Electric on-site to remove heater fan motors in the lab and garage for repair.
- 17: Collected high flow samples due to heavy rain in the area.
- 24: Gerber Electric on-site to install new fan motor for one (1) of the heaters in the garage.
- 24: Completed installation of new 3" check valves on both sanitary pump lines in the grit room as they had failed. Also replaced 90° on sanitary line as it had cracked when replacing check valves.
- 26: Gerber Electric on-site to install second heater motor in the garage and lab.
- 26: Penny's Plumbing on-site to replace toilet.
- 29: High flow sampled collected due to heavy rain events over the weekend.
- 31: Collected high flow samples.

###### **FEBRUARY**

- 01: T&T Power and Gerber Electric on-site to program PLC panels to allow filter backwash pumps to work in auto.
- 02: Completed new plumbing for drain and effluent pumps in basement.
- 13: Received alum delivery.

## MARCH

- 06: Gerber Electric on-site to wire in effluent pump P110.
- 11: Collected high flow samples due to rain events.
- 14: Waddick Fuels on-site to put diesel fuel into the WPCP generator.
- 15: Nevro Mechanical on-site to work on blower 101.
- 15: High flow samples taken.
- 19: Konecranes on-site for annual lift inspections.
- 20: High flow samples taken.
- 21: Brought third sand filter online in consultation with SOM/SPC managers to maximize the overall plant capacity, and to reduce high flow sampling.

## **SECOND QUARTER**

### APRIL

- 09: Cleaned UV channel and put UV racks in for the disinfection period.
- 10: Gerber Electric on site to install new controller for backwash pump P118. T&T power to be on site at a later date to program unit for auto control.
- 12: Collected high flow samples at 12:24 for April 11, 2024.
- 23: Found compressor leaking oil; NCA to be onsite tomorrow.
- 24: NCA replaced inlet on the compressor, and refilled oil.

### MAY

- 03: Completed oil changes on all three blowers.
- 31: Chemtrade on site to deliver alum.

### JUNE

- 11: Completed monthly generator test.
- 25: T&T on site to program the PLC for backwash pump P118 to run in auto.
- 27: Installed temporary alum pump from another site as the two originals are no longer working.
- 30: On call operator on site to take additional samples as per ORO/PCT, T. Thompson.

## **SECTION 7: ALARMS**

### **FIRST QUARTER:**

#### JANUARY

- 26: On-call operator notified day time operator of alarms at the West Lorne Pump Station and WPCP, as they were dealing with more emergent alarms in other areas. WPCP was found to have backwash tank level transmitter fault, drained tank and cleared alarm. The West Lorne Pump Station was found to be in high level due to heavy rain and snow melt. Both pumps on and keeping up with the flow.

#### FEBRUARY

- 17: On-call operator received call at 2201 for zone 2 general alarm. Arrived on-site and found a bar screen fault. Reset fault and ran in manual, forward and backward rotations for several minutes. Put back in auto, watched two run cycles and all appears ok at this time.

#### MARCH

- 10: On-call operator received alarm at 2158 for back wash tank high level. Arrived on-site, put second pump in hand to allow it to pump down and catch up.
- 19: On-call operator received alarm at 2109 for back wash tank high level. Arrived on-site, put second pump in hand to allow it to pump down and catch up.

27: Received alarm call for bar screen fault at 23:37. Cycled back and forth from forward to reverse at bar screen panel to remove large debris caught in the screen. Set back to auto, no other faults.

## **SECOND QUARTER**

### **APRIL**

No Alarms this month

### **MAY**

No Alarms this month

### **JUNE**

30: On call operator received alarm at 14:20 for a power alarm. Operator arrived to site and found that the generator was running. Utility power restored at 17:15 approximately, and on call operator completed plant walk through to ensure operations were normal.

## **SECTION 8: COMPLAINTS & CONCERNS**

### **FIRST QUARTER:**

There were no complaints or concerns reported during the first quarter.

### **SECOND QUARTER**

There were no complaints or concerns reported during the first quarter.